

NUMERICAL ANALYSIS OF DELTA COMPOSITE BEAMS IN FIRE

Chrysanthos Maraveas

School of Mechanical, Aerospace and Civil Engineering, University of Manchester, UK
and C. MARAVEAS PARTNERSHIP – Consulting Engineers, Greece
c.maraveas@maraveas.gr

INTRODUCTION

Various shallow floor systems have been developed recently. The most commonly encountered in the industry are the “slim floor” and the “slim deck” systems. Several companies have developed their own systems, such as the DELTA beam composite deck system [1]. The behavior of such flooring systems when exposed to fire is generally satisfactory, because the encasing concrete acts as thermal insulation, even though the lower flange is unprotected. The results of relevant parametric analyses [2], [3] have shown that the fire resistance of such systems is governed by deflection, because they experience bowing resulting from considerable thermal gradients.

In spite of the fact that the fire behavior of slim floor and slim deck systems has been investigated by various researchers [2], [4] to [9], systems proposed by other manufacturing companies, such as the DELTA beam [1], have not been sufficiently studied at elevated temperatures. Despite this, the manufacturing company certifies (based on experimental testing) that all DELTA beam systems have fire resistances ranging from R.120 to R.180. Due to the absence of vital information for evaluating these tests and the fact that the experimental results are influenced by a number of parameters (e.g. actual strength instead of nominal strength) as well as the arrangement of the beams (moreover, it has been stated [10] that composite beams exhibit better behaviour under fire than anticipated, due to membrane action), the author conducted a numerical simulation of such systems exposed to fire. For this purpose, finite element analyses with the commercial program ABAQUS were carried out. The methodology presented in [2], which was successful in simulating such systems, was followed. The shape and arrangement of DELTA beams [1] are shown in *Fig. 1*. Because according to [3] and the equations proposed by [11], the insulation is less effective for “short” cross-sections, this paper analyzes a beam with a D20-200 [1] cross-section (smallest cross-section). For the dimensions not defined by [1], estimates were made and parametric analyses were carried out.

1 GEOMETRY AND MATERIAL PROPERTIES

1.1 Geometry

The cross-sections shown in *Table 1* (an explanation of the symbols of the dimensions is given in *Fig. 2*) were used in the analyses. These correspond to the geometry of a D20-200 cross-section [1] and estimates were made where there was lack of information. The analysis models included an isolated beam which was simply supported, with a span of 6m (the maximum allowable for these cross-sections [1]) and an effective width (per EN1994-1-1 [12]) of 1,60m.

1.2 Thermal Properties

The thermal properties of the structural steel and the reinforcement used in the analyses were according to EN1993-1-2 [13], while those of concrete followed the specifications of EN1992-1-2 [14]. A more detailed presentation regarding their modelling is given in [2].

1.3 Mechanical Properties and Thermal Expansion

The simulated mechanical properties of steel (S355) followed the EN1993-1-2 [13] specification and those of concrete (C25/30) and reinforcement (S500) were selected according to EN1992-1-2 [14]. Their modeling is described in detail elsewhere [2]. The thermal

expansion was modeled according to the same specifications (the modeling procedure is also given in [2]).

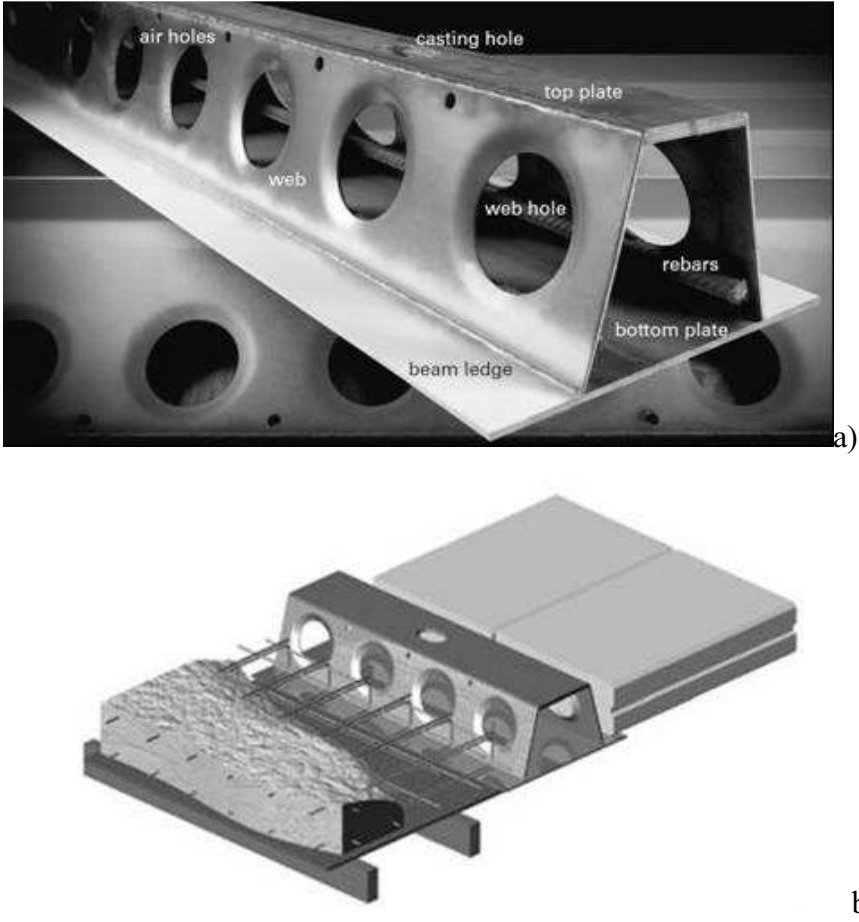


Fig. 1. a) Typical DELTA beam; b) Delta beam with light weight pre-cast concrete element and in-situ casting [1].

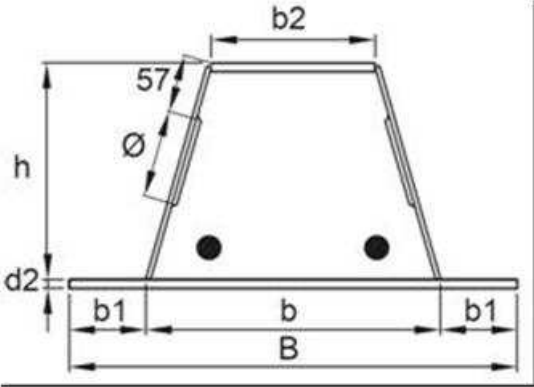


Fig. 2. Dimensions of DELTA beam cross sections [1].

Table 1. Dimensions of DELTA beam cross sections modelled (D20-200) [1].

Cross Section	b (mm)	B (mm)	b1 (mm)	b2 (mm)	d2 (mm)	h (mm)	\varnothing (mm)	Upper flange thickness (mm)	Web thickness (mm)
1	200	395	97.5	100	5	200	80	5	5
2	200	395	97.5	100	5	200	80	5	10
3	200	395	97.5	100	25	200	80	5	5
4	200	395	97.5	100	25	200	80	5	10

2 NUMERICAL MODELLING

2.1 Finite Element Modelling

For the numerical simulation, the commercial program ABAQUS was used. Due to symmetry, half of the beam was modeled and the appropriate boundary conditions were inputted. A representative finite element model is presented in *Fig. 3*. The type of the finite elements used and the simulation details are the same with those given in [2]. The only difference is that in the models presented here, full interaction between the steel beam and the concrete was taken into account.



Fig. 3. 3D finite element model generated for the coupled thermal-structural analysis of DELTA composite beams.

2.2 Thermal Analysis

The simulated beams were exposed to the standard fire curve [15], [16] from below (lower flange), while on the upper surface convection at ambient temperature conditions (20°C) was assumed. The thermal analysis parameters (convection coefficient, radiation emissivity) are those specified in [2] and comply with the regulations of the Eurocodes [12]. A cross-section of the finite element model, together with the boundary conditions, is shown in *Fig. 4*.

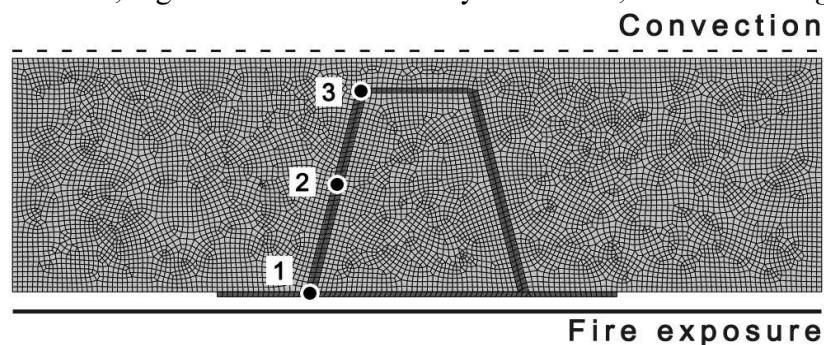


Fig. 4. Finite element model generated for the thermal analysis of DELTA composite beams, including boundary conditions. Temperature evolution is shown for nodes 1 (lower flange) 2 (web mid-height) and 3 (lower flange).

2.3 Structural Analysis

For the structural analysis, a uniform load of 15 kN/m, which corresponds to the maximum load of 30 kN/m for D2-200 beams [1] (half of the cross-section was simulated), was applied at time $t=0$. The remaining parameters for the static analyses are listed elsewhere [2]. A total of eight analyses (two for each beam) were performed. In four of them, the thermal expansion was neglected for the purpose of investigating its effect on the simulation results.

3 NUMERICAL RESULTS

3.1 Thermal Response

The thermal analysis results showed that the temperature increase at the lower (unprotected) flange is considerable (e.g. temperatures as high as 700°C and 850°C were calculated for 60 min and 90 min of ISO standard fire [15] exposure, respectively). On the contrary, the upper

flange, which was well protected, experienced temperatures around 70°C and 120°C for 60 min and 90 min exposure to fire, respectively. Minor variations in the thermal profile, depending on the dimensions of the cross-section (Table 1), were observed. The temperature evolution with time is presented in Fig. 5. The results show that the beams experience a severe temperature gradient, with temperature differences between the upper and lower flange ranging from 630°C to 800°C (for fire exposures ranging from 60min to 120min respectively).

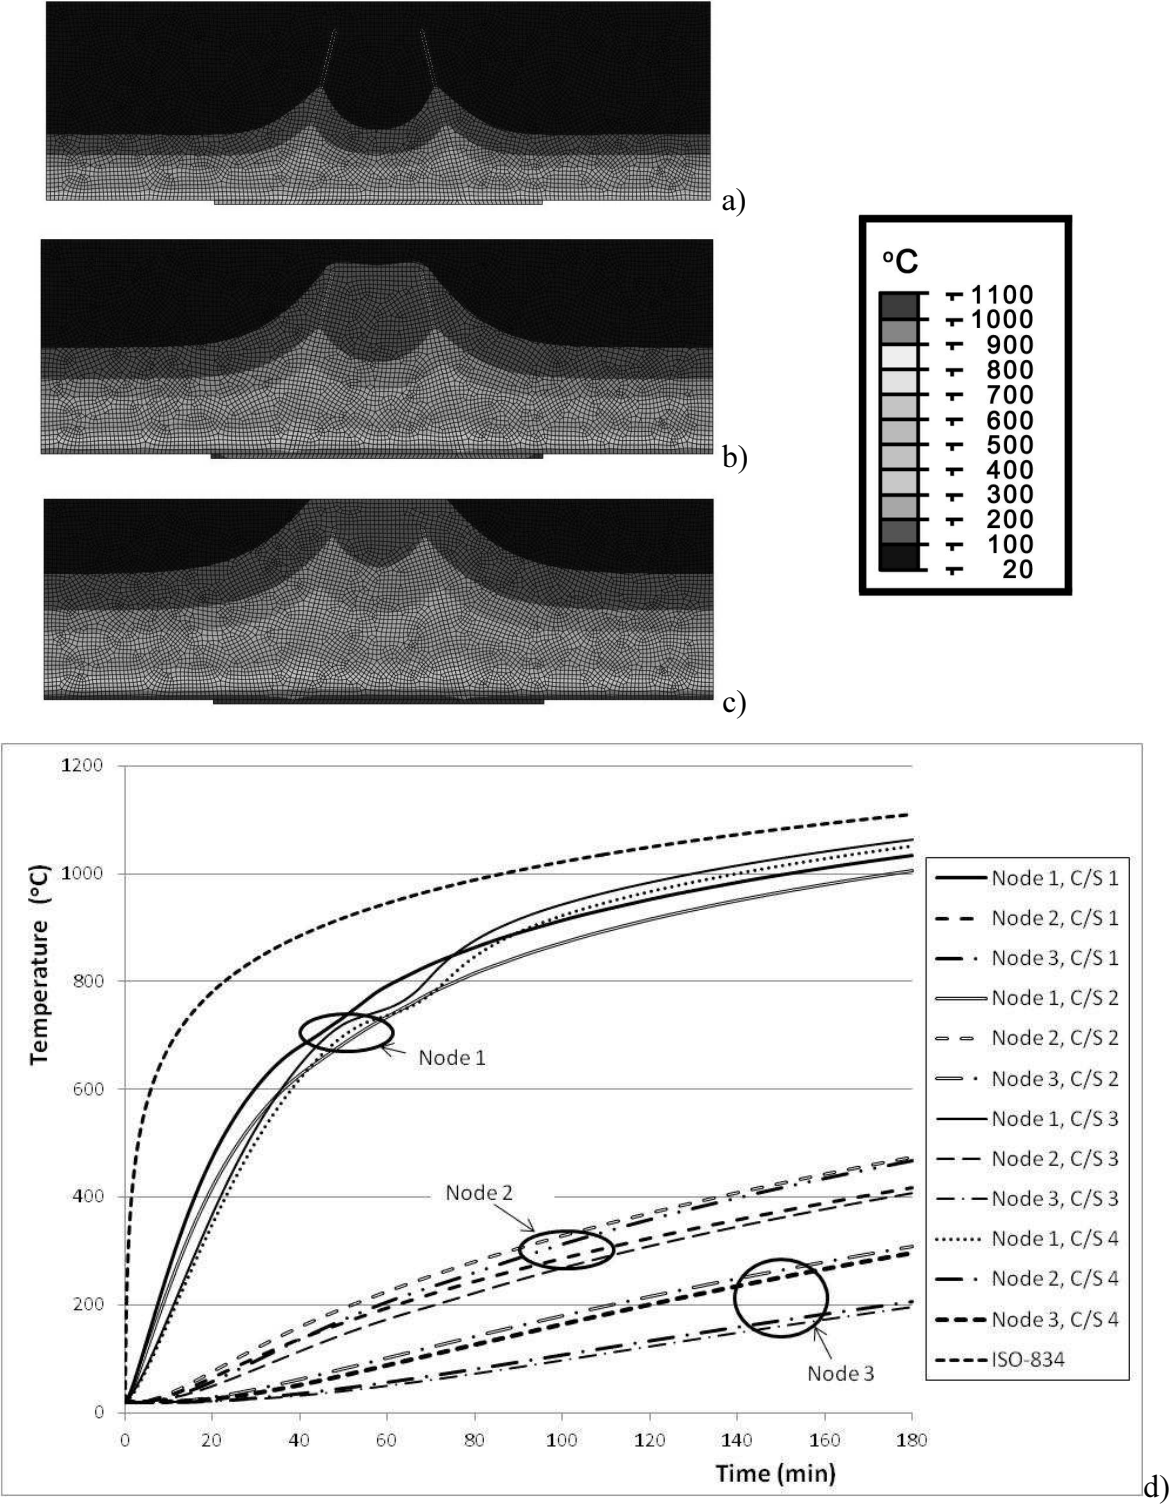


Fig. 5. Thermal response of Cross Section 1 (Table 1) exposed to ISO 834 fire [15] for a) 60min, b) 120min and c) 180min and d) temperatures at nodes of Fig. 3 for the cross sections of Table 1.

3.2 Structural Response

The results of the static analyses are presented in Fig. 6. From these it is clear that the beams experience severe bowing and their response is controlled by deflections. This is anticipated,

because the lower flange expands in a major way due to the significant temperature rise, in contrast to the remainder of the cross-section which experiences low temperatures. Based on the calculated deflections, the fire resistance appears to be approximately 60 min (R60), assuming a deflection limit (which is typical for fire tests according to conventional wisdom) of $L/30$, where L is the span of the beam. On the contrary, when the thermal expansion is neglected, failure occurs after 150 min of exposure. It is also notable that when thermal expansion is taken into account, beams with thinner flanges fail first. This is to be expected, as increased thickness improves the resistance of the exposed lower flange. However, when thermal expansion is neglected, beams with thicker webs (10mm thickness) exhibit greater fire resistances.

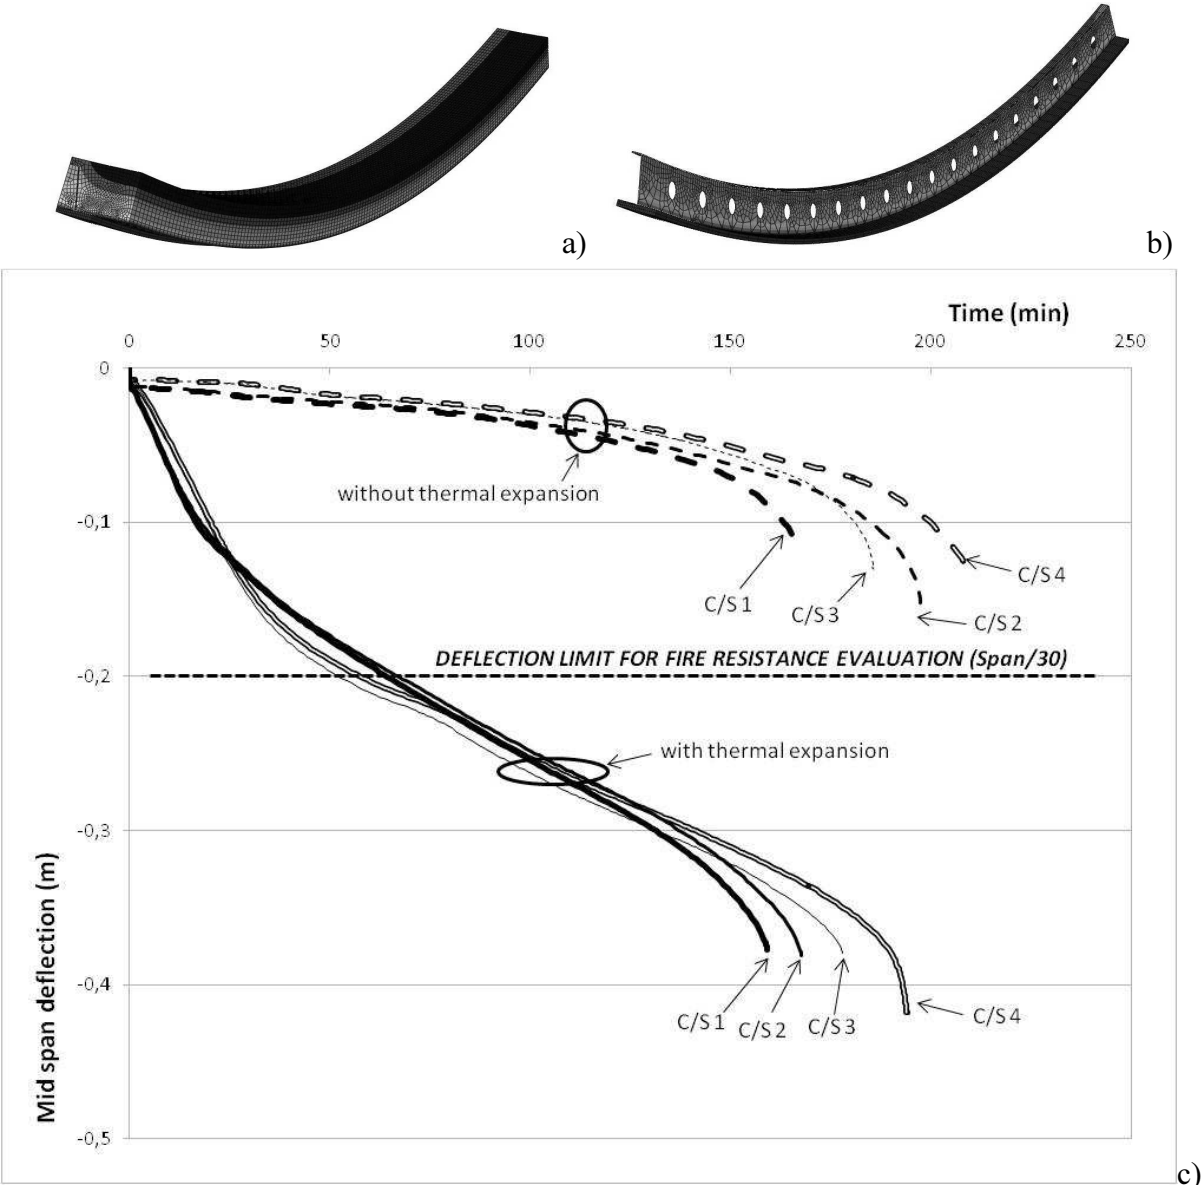


Fig. 6. Structural response of DELTA composite beams exposed to ISO 834 fire [15]. a) Deformed FE model for 120min exposure with temperature contours, b) Deformed shape of the steel part only (FE model) with temperature contours after 120min exposure c) mid-span deflection as a function of the duration of exposure.

4. CONCLUSIONS

Based on an overall evaluation of the analysis results, the following conclusions can be drawn:

- Composite DELTA beams exhibit severe thermal gradients and are subjected to intense bowing when exposed to fire from below.

- The fire resistance of these beams is governed by deflections resulting from thermal gradients and bowing.
- Despite the limited knowledge regarding the conducted fire tests by the manufacturing company, their results seem to overpredict the fire resistance of such beams. However, more information on these tests is necessary to further evaluate the results.
- The fire resistance of these beams is satisfactory and is conservatively estimated to be approximately 60min for standard fire exposure.

REFERENCES

- [1] Deltabeam Technische Handleiding, downloaded from <http://www.peikko.com>, accessed 19-12-2013.
- [2] Maraveas C., Swailes T., Wang Y.C., 2012. "A detailed methodology for the finite element analysis of asymmetric slim floor beams in fire". *Steel Construction*, Vol. 5, No. 3, pp. 191-198.
- [3] Maraveas C., Wang Y.C., Swailes T., 2014. "Fire Resistance of 19th Century fireproof flooring systems: A sensitivity analysis". *Construction and Building Materials*, Vol. 55, pp. 69-81.
- [4] Bailey CG., 1999. "The behaviour of asymmetric slim floor steel beams in fire". *Journal of Constructional Steel Research*, Vol. 50, pp. 235-257.
- [5] Newman GM., 1995. "Fire resistance of slim floor beams". *Journal of Constructional Steel Research*, Vol. 33, pp. 87-100.
- [6] Ma Z., Mäkeläinen P., 2000. "Behaviour of composite slim floor structures in fire". *Journal of Structural Engineering*, ASCE, Vol. 126, No. 7, pp. 830-837.
- [7] Mäkeläinen P., Ma Z., 2000. "Fire resistance of composite slim floor beams". *Journal of Constructional Steel Research*, Vol. 54, pp. 345-363.
- [8] Ellobody E., 2011. "Nonlinear behaviour of unprotected composite slim floor steel beams exposed to different fire conditions". *Thin-Walled Structures*, Vol. 49, pp. 762-771.
- [9] Both C., Fellingner JHH., Twilt L., 1997. "Shallow floor construction with deep composite deck: from fire tests to simple calculation rules". *Heron*, Vol. 42, No. 3, pp. 145-158.
- [10] Wang Y.C., 1996. "Tensile membrane action in slabs and its application to the Cardington tests", *Second Cardington Conference*, BRE, Watford, U.K.
- [11] Zaharia R., Franssen J.M., 2012. "Simple equations for the calculation of temperature within the cross-section of slim floor beams under ISO fire". *Steel and Composite Structures*, Vol. 13, No. 2, pp. 171-185.
- [12] EN 1994-1-1, 2005. *Eurocode 4 - Design of composite steel and concrete structures - Part 1-1: General rules and rules for buildings* CEN, Brussels.
- [13] EN 1993-1-2, 2005. *Eurocode 3 - Design of steel structures - Part 1-2: General rules - Structural fire design*, CEN Brussels.
- [14] EN 1992-1-2, 2004. *Eurocode 2 - Design of concrete structures - Part 1-2: General rules - Structural fire design*, CEN Brussels.
- [15] ISO 834-1, 1999. *Fire resistance tests-elements of building construction-Part 1: General requirements*.
- [16] EN 1991-1-2, 2002. *Eurocode 1 – Actions on structures - Part 1-2: General actions – Actions on structures exposed to fire*. CEN Brussels.

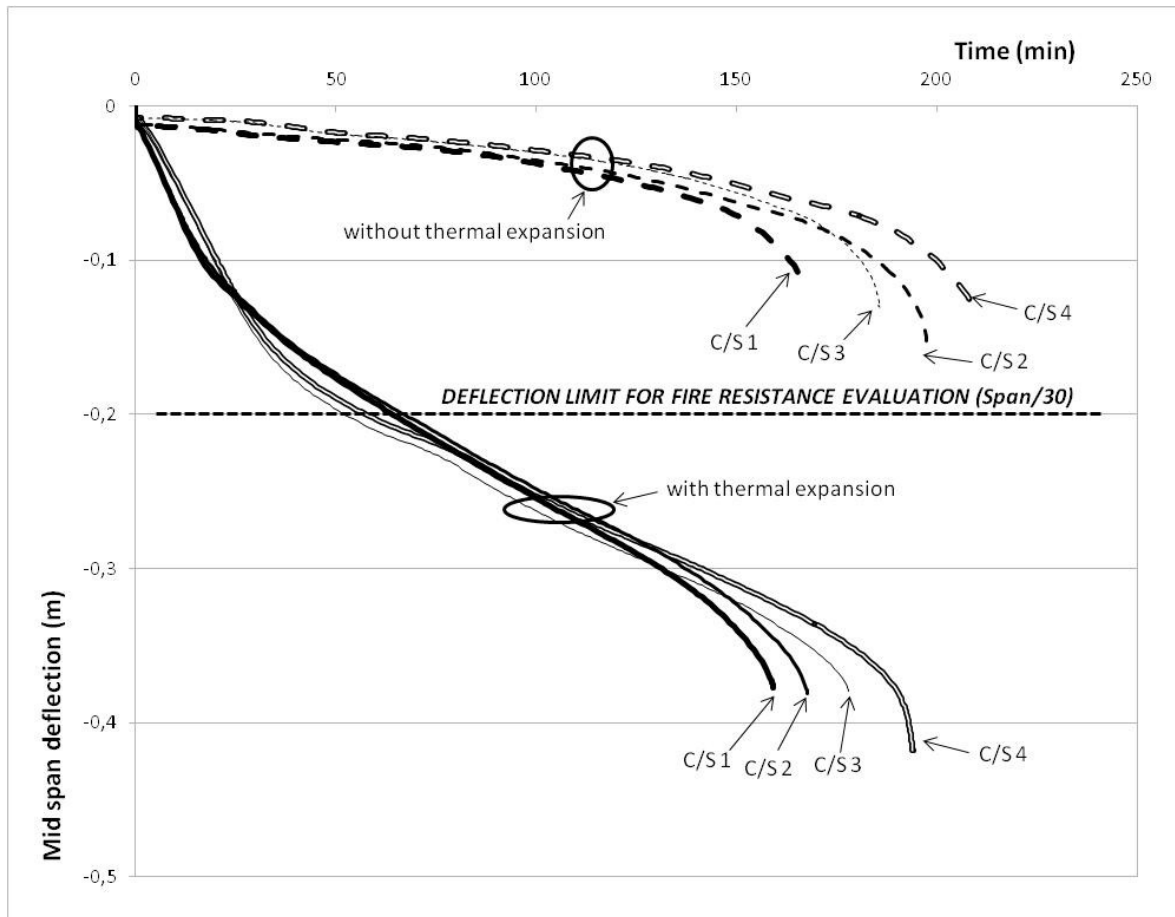


Fig. 1. Mid-span deflection as a function of time for DELTA composite beams exposed to ISO 834 fire [3]

Based on an overall evaluation of the analysis results, the following conclusions can be drawn:

- Composite DELTA beams exhibit severe thermal gradients and are subjected to intense bowing when exposed to fire from below.
- The fire resistance of these beams is governed by deflections resulting from thermal gradients and bowing.
- Despite the limited knowledge regarding the conducted fire tests by the manufacturing company, their results seem to overpredict the fire resistance of such beams. However, more information on these tests is necessary to further evaluate the results.
- The fire resistance of these beams is satisfactory and is conservatively estimated to be approximately 60min for standard fire exposure.

REFERENCES

- [1] Deltabeam Technische Handleiding, downloaded from <http://www.peikko.com>, accessed 19-12-2013.
- [2] Maraveas C., Swailes T., Wang Y.C., 2012. "A detailed methodology for the finite element analysis of asymmetric slim floor beams in fire". *Steel Construction*, Vol. 5, No. 3, pp. 191-198.
- [3] ISO 834-1, 1999. *Fire resistance tests-elements of building construction-Part 1: General requirements*.